


Lawton Adams Construction Co.
260 Route 100 Somers, NY 10589
(914) 232-3275

Sieve Analysis Report

Sample ID	16887	Notes:
Sample Date	2/10/2025	
Weather	N/A	
Collection Point	Stock Pile	
Material	1/4" WASHED GRAVEL	
Method	Dry	

Standard Spec	Washed 1/4"	FM:	2.56	AFS:	4.13
----------------------	-------------	------------	------	-------------	------


Sieve Size		Weight	Percent Retained	Cumulative % Passing	Cumulative % Retained	Spec Limits
US	MM					
1/2 in.	12.7mm	0	.00	100.0	.0	0
3/8 in.	9.51mm	1.25	.23	99.8	.2	0
1/4 in.	6.35mm	150.55	27.84	71.9	28.1	0
No. 4	4.76mm	251.65	46.54	25.4	74.6	0
No. 8	2.38mm	118.25	21.87	3.5	96.5	0
No. 16	1.19mm	5.95	1.10	2.4	97.6	0
No. 50	0.297mm	5.05	.93	1.5	98.5	0
No. 200	0.074mm	2.4	.44	1.0	99.0	0
Pan	0mm	5.65	1.04	.0	100.0	0
Total:		540.75	Sample Wt	540.7	% Diff	0.00925

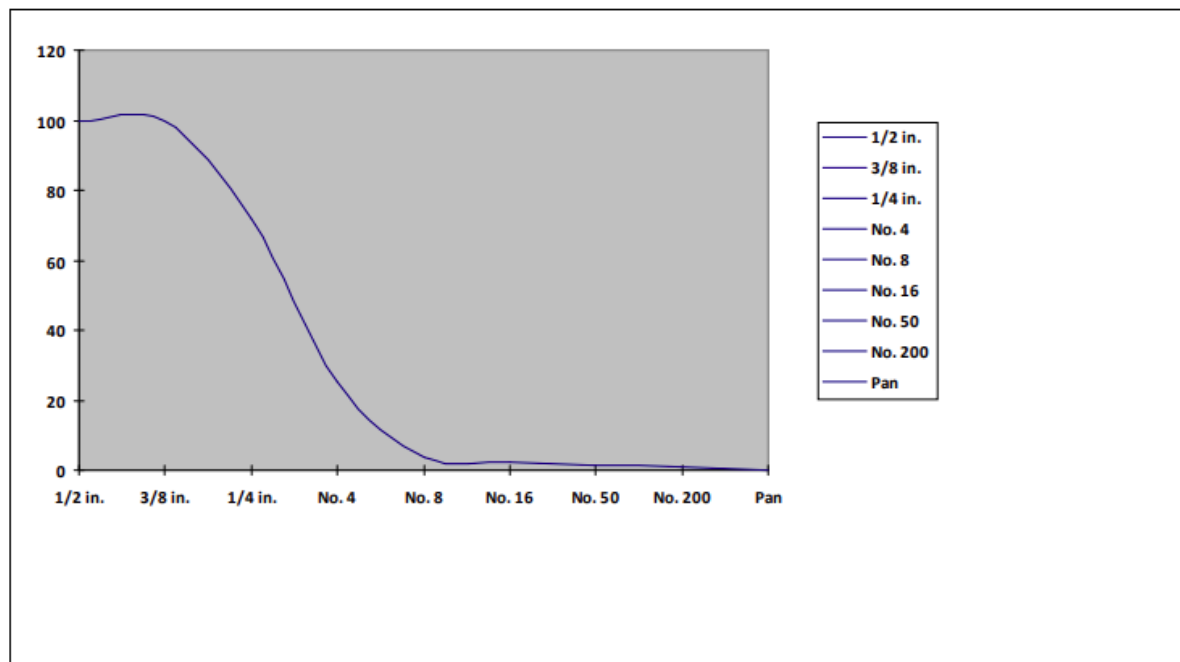

Lawton Adams Construction Co.
 260 Route 100 Somers, NY 10589
 (914) 232-3275

Sieve Analysis Report

Sample ID	17304	Notes:				
Sample Date	6/20/2025					
Weather	N/A					
Collection Point	Stock Pile					
Material	3/4 inch Washed Billings					
Method	Dry					
Standard Spec	3/4 inch Washed Billings (no. 6)				FM:	2.53
					AFS:	3.93
Sieve Size		Weight	Percent Retained	Cumulative % Passing	Cumulative % Retained	Spec Limits
US	MM					
2 in.	50mm	0	.00	100.0	.0	100
1 in.	25.4mm	0	.00	100.0	.0	100
3/4 in.	19mm	281.3	48.20	51.8	48.2	90-100
1/2 in.	12.7mm	276.4	47.36	4.4	95.6	20-55
3/8 in.	9.51mm	14.3	2.45	2.0	98.0	0-15
No. 4	4.76mm	2.75	.47	1.5	98.5	0-5
No. 8	2.38mm	.7	.12	1.4	98.6	0
No. 16	1.19mm	.5	.09	1.3	98.7	0
Pan	0mm	7.65	1.31	.0	100.0	0
Total:		583.6	Sample Wt	0% Diff	0	

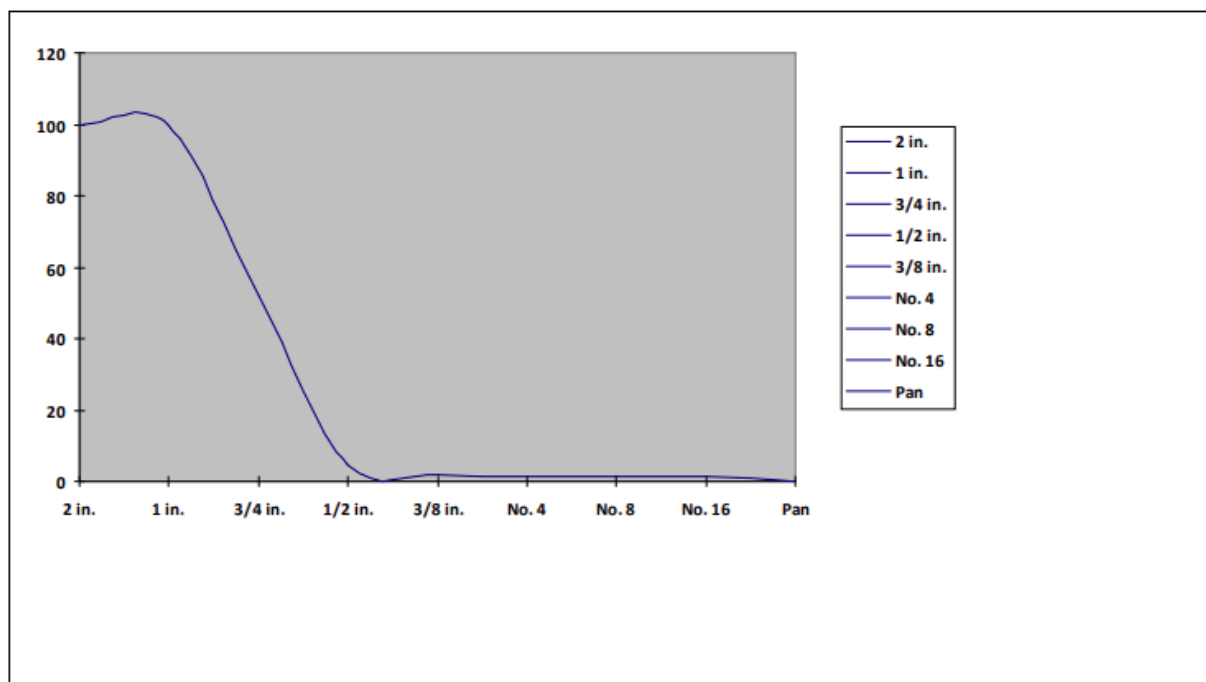

Lawton Adams Construction Co.
 260 Route 100 Somers, NY 10589
 (914) 232-3275

Sieve Analysis Report

Sample ID	17329	Notes:
Sample Date	7/2/2025	
Weather	N/A	
Collection Point	Conveyer Belt	
Material	3/8" WASHED GRAVEL	
Method	Dry	

Standard Spec	ASTM C 33 3/8" to No. 8 Size	FM:	2.67	AFS:	4.39
----------------------	------------------------------	------------	------	-------------	------

Sieve Size		Weight	Percent Retained	Cumulative % Passing	Cumulative % Retained	Spec Limits
US	MM					
1/2 in.	12.7mm	111.95	19.85	80.2	19.8	100
3/8 in.	9.51mm	199.75	35.41	44.7	55.3	85-100
No. 4	4.76mm	222.05	39.37	5.4	94.6	10-30
No. 8	2.38mm	19	3.37	2.0	98.0	0-10
No. 16	1.19mm	3.05	.54	1.5	98.5	0-5
Pan	0mm	8.25	1.46	.0	100.0	0
Total:		564.05	Sample Wt	563.8	% Diff	0.04434

